





The installation should be carried out by an electrician or by any similarly qualified person.



1

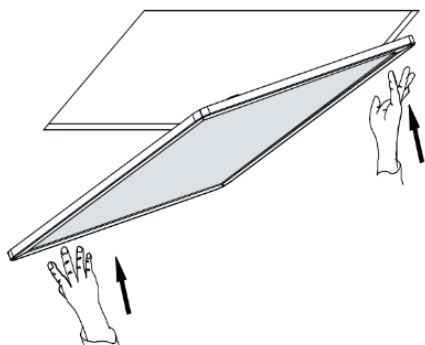


2

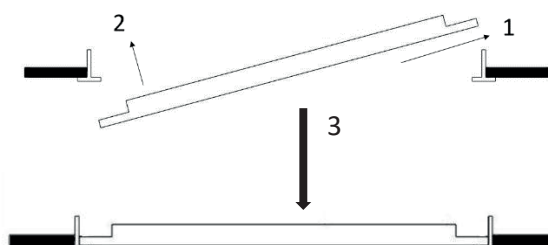


Adjust the module position to fit ceiling well.

### Fixation of the optional safety cables

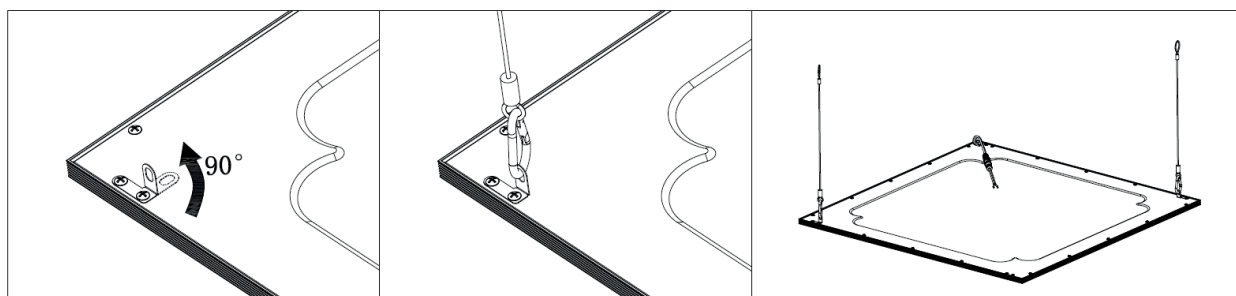

### Connection of the driver

Panel cable must be attached with strain relief protection

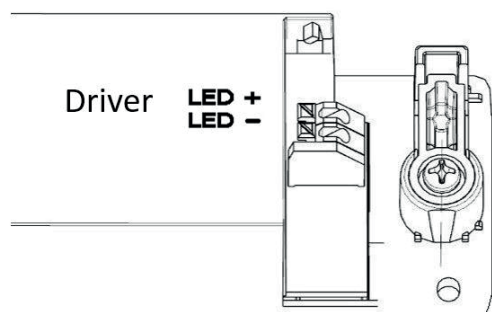

Brown +

Panel Cable

Blue -

Cable length: 250mm  
Wire diameter: 0.5mm<sup>2</sup>



## Warning

**Please read these instructions carefully before attempting to install this product.**

- This product is designed for installation on a T-bar ceiling system only.
- Safety cable connection with the hook is recommended for safety purposes only. The hook cannot be used for suspending the module.
- Please follow this installation guide strictly.
- The module can only be installed into a ceiling that is perfectly horizontal and is safely suspended to a carrying structure.
- The module shall only be installed or replaced by a qualified electrician and connected in accordance with latest IEE electrical regulations or national requirements.
- If the external flexible cord of this module is damaged, it shall be exclusively replaced by the manufacturer or his service agent or a similar qualified person in order to avoid a hazard.
- The supply cord and cable provided with the module is intended is for indoor use only.
- This module is intended for indoor use only.
- In any case, insulation matting or other similar materials cannot cover the module.



## CAUTION

### **RISK OF BURN INJURIES**

During and after use the unit may be hot. Do not touch the unit before it has completely cooled down.

**Failure to follow these instructions can result in minor injuries, or equipment damage.**